



**NFRC 102-2014 THERMAL PERFORMANCE
TEST REPORT**

Rendered to:

CMI ARCHITECTURAL PRODUCT, INC

SERIES/MODEL: 450 DT System

TYPE: Glazed Wall Systems (Site-built)

Summary of Results			
Standardized Thermal Transmittance (U-Factor)			0.33
Unit Size:	79" x 79" (2007 mm x 2007 mm) (Model Size)		
Layer 1:	1/4"	PPG SB60 (e=0.035*, #2)	
Gap 1:	0.50"	TS-D: Thermo-plastic with stainless steel substrate Spacer	90% Argon*
Layer 2:	1/4"	Clear	

Reference must be made to Report No. G9649.01-201-46, dated 08/10/17 for complete test specimen description and data.



NFRC 102-2014 THERMAL PERFORMANCE TEST REPORT

Rendered to:

CMI ARCHITECTURAL PRODUCT, INC
1630 101st Avenue NE Suite 130
Blaine, Minnesota 55449

Report Number: G9649.01-201-46
Test Date: 07/27/17
Report Date: 08/10/17

Test Sample Identification:

Series/Model: 450 DT System

Type: Glazed Wall Systems (Site-built)

Overall Size: 79" x 79" (2007 mm x 2007 mm) (Model Size)

NFRC Standard Size: 78.7" x 78.7" (2000 mm wide x 2000 mm high)

Test Sample Submitted by: Client

Test Procedure: U-Factor tests were performed in a Guarded Hot Box in accordance with NFRC 102-2014, *Procedure for Measuring the Steady-State Thermal Transmittance of Fenestration Systems*.

Test Results Summary:

Standardized U-factor (U_{st}): 0.33 Btu/hr·ft²·F (CTS Method)

Test Sample Description:

Frame:

Material:	AT (0.50"): Aluminum with Thermal Breaks - All Members		
Size:	79" x 79" (Model Size)		
Daylight Opening:	36-1/4" x 76-3/4" (x2)	Glazing Method:	Exterior
Exterior Color:	Gray	Exterior Finish:	Mill Finish
Interior Color:	Gray	Interior Finish:	Mill Finish
Corner Joinery:	Square Cut / Screws / Sealed		

Glazing Information:

Layer 1:	1/4"	PPG SB60 (e=0.035*, #2)	
Gap 1:	0.50"	TS-D: Thermo-plastic with stainless steel substrate Spacer	90% Argon*
Layer 2:	1/4"	Clear	
Gas Fill Method:	Single-Probe Method*		

**Stated per Client/Manufacturer*

N/A Non-Applicable

Test Sample Description: (Continued)

Weatherstripping:

Description	Quantity	Location
Rubber gasket	1 Row	Frame Perimeter

Hardware:

Description	Quantity	Location
No hardware		

Drainage:

Drainage Method	Size	Quantity	Location
Punched weephole	1/4" x 1/4"	4	Sill

Thermal Transmittance (U-factor)

Measured Test Data

Heat Flows

1. Total Measured Input into Metering Box (Q_{total})	1135.04 Btu/hr
2. Surround Panel Heat Flow (Q_{sp})	62.65 Btu/hr
3. Surround Panel Thickness	5.00 inches
4. Surround Panel Conductance	0.0354 Btu/hr·ft ² ·F
5. Metering Box Wall Heat Flow (Q_{mb})	44.39 Btu/hr
6. EMF vs Heat Flow Equation (equivalent information)	0.0201*EMF + 27.910
7. Flanking Loss Heat Flow (Q_{fl})	-6.23 Btu/hr
8. Net Specimen Heat Loss (Q_s)	1034.23 Btu/hr

Areas

1. Test Specimen Projected Area (A_s)	43.34 ft ²
2. Test Specimen Interior Total (3-D) Surface Area (A_h)	49.53 ft ²
3. Test Specimen Exterior Total (3-D) Surface Area (A_c)	48.20 ft ²
4. Metering Box Opening Area (A_{mb})	68.75 ft ²
5. Metering Box Baffle Area (A_{b1})	60.57 ft ²
6. Surround Panel Interior Exposed Area (A_{sp})	25.41 ft ²

Test Conditions

1. Average Metering Room Air Temperature (t_h)	69.80 F
2. Average Cold Side Air Temperature (t_c)	-0.19 F
3. Average Guard/Environmental Air Temperature	72.99 F
4. Metering Room Average Relative Humidity	5.42 %
5. Metering Room Maximum Relative Humidity	5.61 %
6. Metering Room Minimum Relative Humidity	5.24 %
7. Measured Cold Side Wind Velocity (Perpendicular Flow)	15.00 mph
8. Measured Warm Side Wind Velocity (Parallel Flow)	0.05 mph
9. Measured Static Pressure Difference Across Test Specimen	0.00" ± 0.04"H ₂ O

Average Surface Temperatures

1. Metering Room Surround Panel	69.64 F
2. Cold Side Surround Panel	0.06 F

Results

1. Thermal Transmittance of Test Specimen (U_s)	0.34 Btu/hr·ft ² ·F
2. Standardized Thermal Transmittance of Test Specimen (U_{st})	0.33 Btu/hr·ft ² ·F

Thermal Transmittance (U-factor)

Calculated Test Data

CTS Method

1. Warm Side Emittance of Glass (e_i)	0.84
2. Cold Side Emittance of Glass	0.84
3. Warm Side Frame Emittance*	0.05
4. Cold Side Frame Emittance*	0.05
5. Warm Side Sash/Panel/Vent Emittance*	N/A
6. Cold Side Sash/Panel/Vent Emittance*	N/A
7. Warm Side Baffle Emittance (e_{b1})	0.92
8. Cold Side Baffle Emittance (e_{b2})	N/A
9. Equivalent Warm Side Surface Temperature	52.56 F
10. Equivalent Cold Side Surface Temperature	4.43 F
11. Warm Side Baffle Surface Temperature	69.77 F
12. Cold Side Baffle Surface Temperature	N/A F
13. Measured Warm Side Surface Conductance (h_h)	1.38 Btu/hr·ft ² ·F
14. Measured Cold Side Surface Conductance (h_c)	5.17 Btu/hr·ft ² ·F
15. Test Specimen Thermal Conductance (C_s)	0.50 Btu/hr·ft ² ·F
16. Convection Coefficient (K_c)	0.31 Btu/(hr·ft ² ·F ^{1.25})
17. Radiative Test Specimen Heat Flow (Q_{rl})	565.11 Btu/hr
18. Conductive Test Specimen Heat Flow (Q_{cl})	469.12 Btu/hr
19. Radiative Heat Flux of Test Specimen (q_{rl})	13.04 Btu/hr·ft ² ·F
20. Convective Heat Flux of Test Specimen (q_{cl})	10.82 Btu/hr·ft ² ·F
21. Standardized Warm Side Surface Conductance (h_{sth})	1.19 Btu/hr·ft ² ·F
22. Standardized Cold Side Surface Conductance (h_{stc})	5.28 Btu/hr·ft ² ·F
23. Standardized Thermal Transmittance (U_{st})	0.33 Btu/hr·ft ² ·F

Test Duration

1. The environmental systems were started at 12:00 hours, 07/26/17.
2. The test parameters were considered stable for two consecutive four hour test periods from 23:59 hours, 07/26/17 to 07:59 hours, 07/27/17.
3. The thermal performance test results were derived from 03:59 hours, 07/27/17 to 07:59 hours, 07/27/17.

The reported Standardized Thermal Transmittance (U_{st}) was determined using CTS Method, per Section 9.2(A) of NFRC 102.

**Stated per NFRC 101*

Glazing Deflection:

	Left Glazing	Right Glazing
Edge Gap Width	0.50"	0.50"
Estimated center gap width upon receipt of specimen in laboratory (after stabilization)	0.51"	0.51"
Center gap width at laboratory ambient conditions on day of testing	0.51"	0.51"
Center gap width at test conditions	0.44"	0.45"

Glass collapse determined using a digital glass and air space meter

The sample was inspected for the formation of frost or condensation, which may influence the surface temperature measurements. The sample showed no evidence of condensation/frost at the conclusion of the test.

“This test method does not include procedures to determine the heat flow due to either air movement through the specimen or solar radiation effects. As a consequence, the thermal transmittance results obtained do not reflect performances which are expected from field installations due to not accounting for solar radiation, air leakage effects, and the thermal bridge effects that have the potential to occur due to the specific design and construction of the fenestration system opening. The latter can only be determined by in-situ measurements. Therefore, it is important to recognize that the thermal transmittance results obtained from this test method are for ideal laboratory conditions and should only be used for fenestration product comparisons and as input to thermal performance analyses which also include solar, air leakage and thermal bridge effects.”

The test sample was installed in a vertical orientation, the exterior of the specimen was exposed to the cold side. The direction of heat transfer was from the interior (warm side) to the exterior (cold side) of the specimen. The ratings were rounded in accordance to NFRC 601, NFRC Unit and Measurement Policy. The data acquisition frequency is 5 minutes.

ANSI/NCSL Z540-2-1997 type B uncertainty for this test was 1.69%.

Required annual calibrations for the Architectural Testing Inc., an Intertek company ("Intertek-ATI"), 'thermal test chamber' (ICN N000235) in St. Paul, Minnesota were last conducted in November 2016 in accordance with Intertek-ATI calibration procedure. A CTS Calibration verification was performed November 2016. A Metering Box Wall Transducer and Surround Panel Flanking Loss Characterization was performed November 2016.

"Ratings included in this report are for submittal to an NFRC licensed IA for certification purposes and are not meant to be used for labeling purposes. Only those values identified on a valid Certification Authorization Report (CAR) are to be used for labeling purposes."

Intertek-ATI will service this report for the entire test record retention period. Test records that are retained such as detailed drawings, datasheets, representative samples of test specimens, or other pertinent project documentation will be retained by Intertek-ATI for the entire test record retention period. The test record retention end date for this report is July 27, 2022.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the specimen tested. This report may not be reproduced, except in full, without the written approval of Intertek-ATI.

For INTERTEK-ATI

Tested By:

Reviewed By:

George Radysh
Thermal Technician

Dan A. Johnson
Director – Regional Operations
Individual-In-Responsible-Charge

GR: daj/wmr
G9649.01-201-46

Attachments (pages): This report is complete only when all attachments listed are included.

- Appendix-A: CTS Calibration Data (1)
- Appendix-B: Surround Panel Wiring Diagram (1)
- Appendix-C: Baffle Wiring Diagram (1)
- Appendix-D: Drawings (10)


Revision Log

<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
01-R0	08/10/17	All	Original Report Issue. Work requested by Geoffrey Helm of CMI Architectural Product, Inc.


Appendix A: CTS Calibration Data

1. CTS Test Date	02/10/17
2. CTS Size	43.06 ft ²
3. CTS Glass/Core Conductance	0.40 Btu/hr·ft ² ·F
4. Warm Side Air Temperature	69.78 F
5. Cold Side Air Temperature	-0.37 F
6. Warm Side Average Surface Temperature	54.68 F
7. Cold Side Average Surface Temperature	3.23 F
8. Convection Coefficient (K _c)	0.31 Btu/(hr·ft ² ·F ^{1.25})
9. Measured Cold Side Surface Conductance (h _c)	5.71 Btu/hr·ft ² ·F
10. Measured Thermal Transmittance	0.31 Btu/hr·ft ² ·F


Appendix B: Surround Panel Wiring Diagram

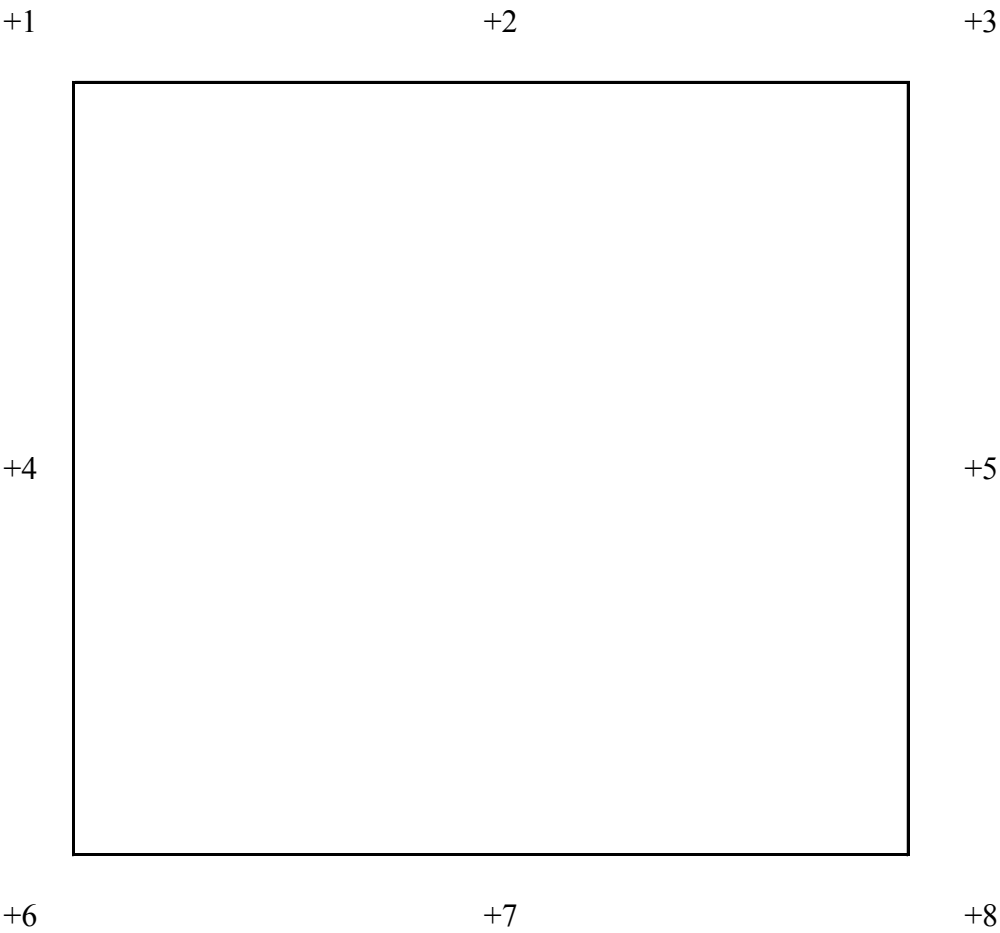




Appendix C: Baffle Wiring Diagram

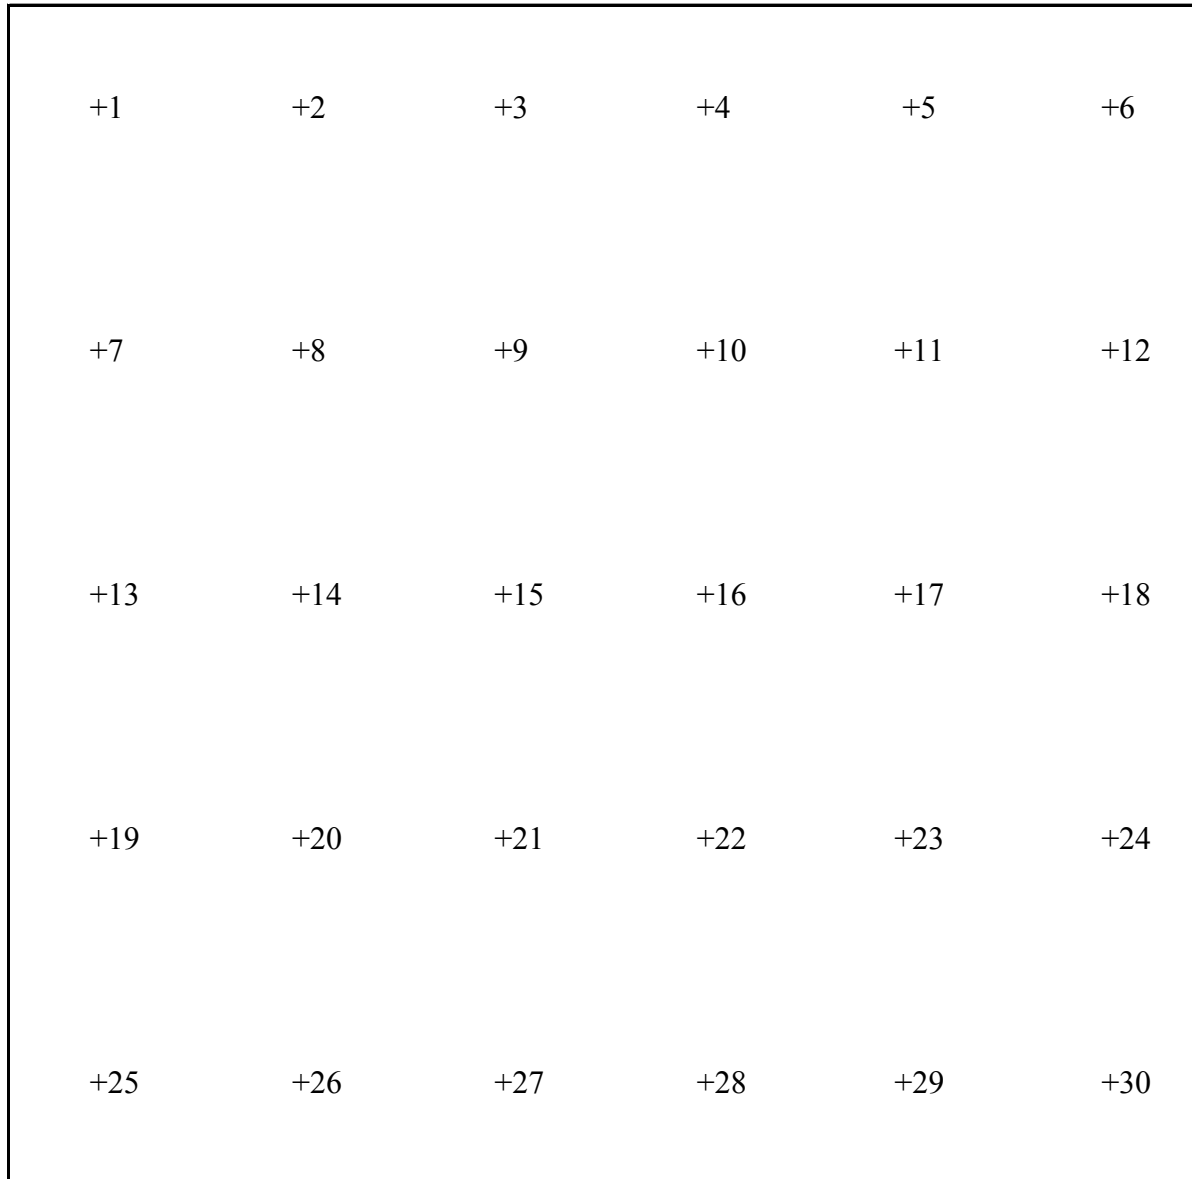

Appendix D: Drawings

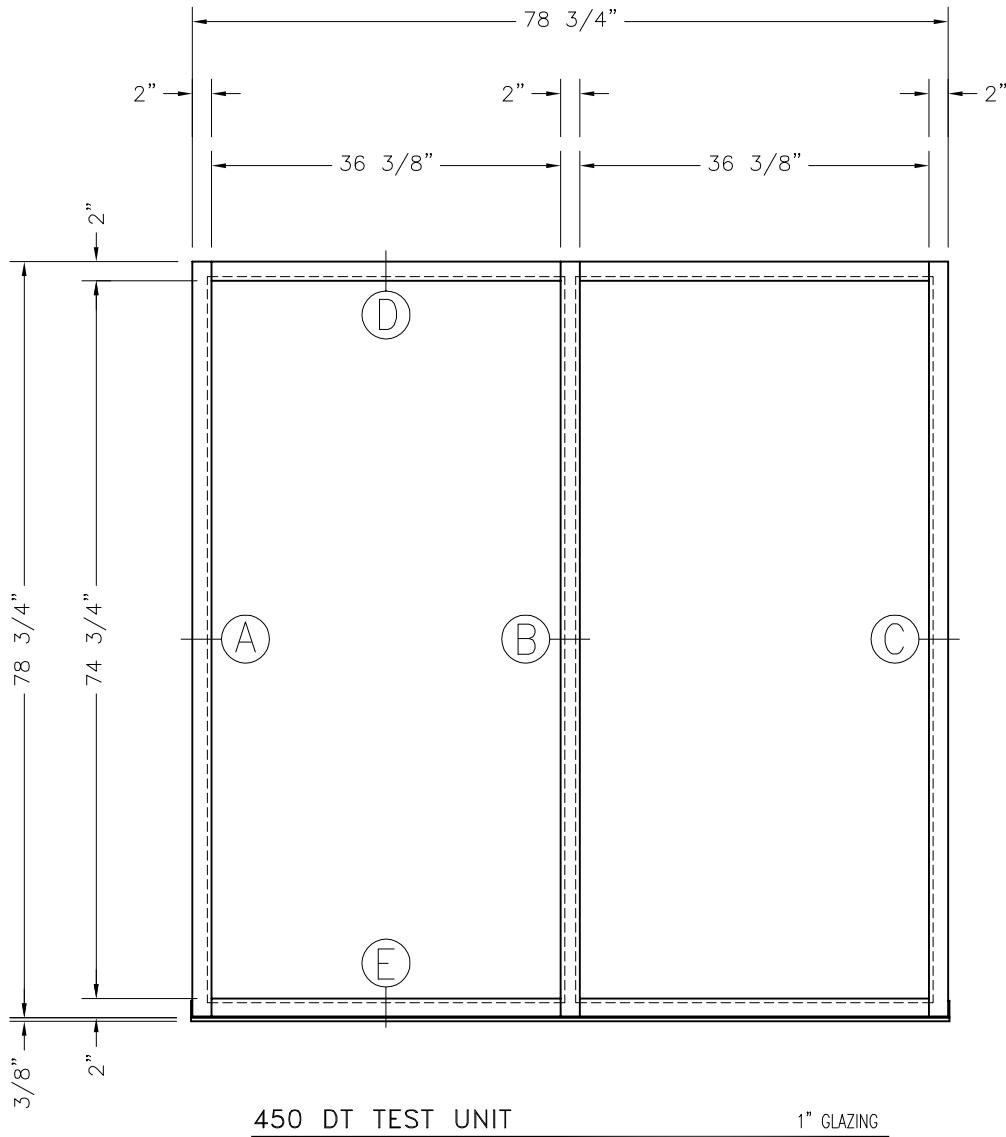

PARTS LIST:		
#	USE	DESCRIPTION
46-010	GLASS STOP	6063-T6 ALUMINUM
47-501	SILL	6063-T6 ALUMINUM DUAL POLYURETHANE THERMAL BREAK
47-502	HEAD/JAMB/VERTICAL	6063-T6 ALUMINUM DUAL POLYURETHANE THERMAL BREAK
47-512	VERTICAL FILLER	6063-T6 ALUMINUM DUAL DUROMETER PVC THERMAL BREAK
47-535	SUB-SILL	6063-T6 ALUMINUM DUAL POLYURETHANE THERMAL BREAK
32-071-09	PERIMETER FILLER	PVC
19-120	GLAZING GASKET	EPDM 70 ± 5 DUROMETER
12-037	FASTENERS	12-14 X 1 1/4" PPH TYPE AB, THREAD TAPPING SCREW, CLEAR ZINC PLATED

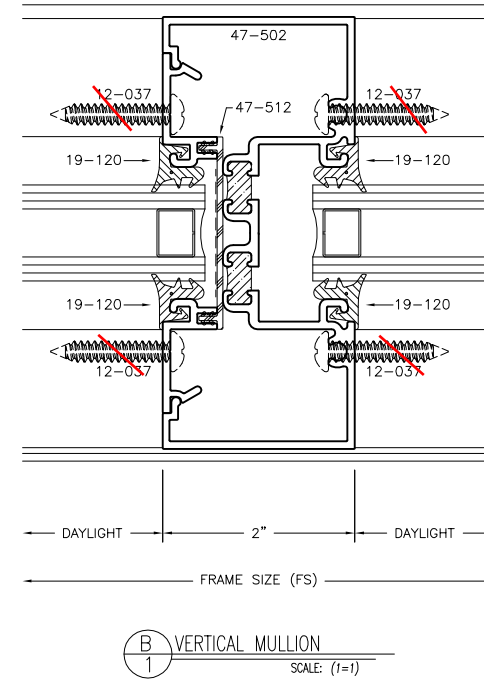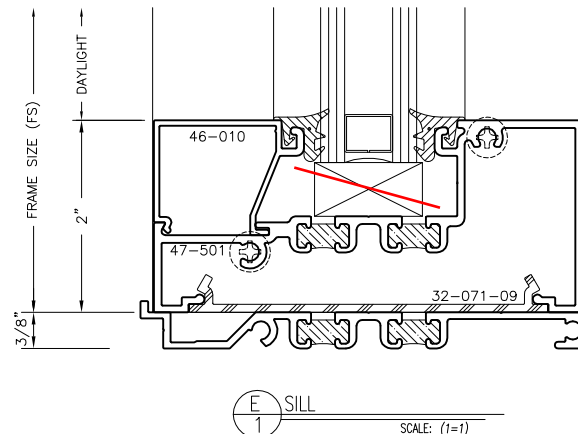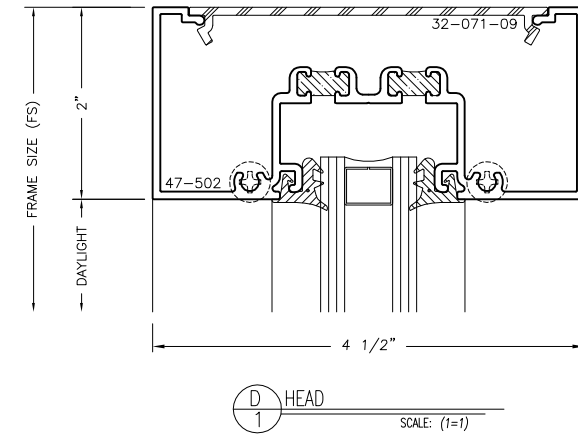

	Report #:	G9649
	Date:	08/07/17
	Verified by:	<i>[Signature]</i>

THIS DRAWING IS PREPARED FOR THE SOLE USE OF OBTAINING APPROVAL FOR MATERIAL SHOWN. CMI-ARCHITECTURAL ASSUMES NO RESPONSIBILITY FOR THE DESIGN OR CONSTRUCTION OF THE PROJECT. THE USER OF THESE DRAWINGS, PERMITTER AND ASSUREE, SHALL BE RESPONSIBLE FOR THE DESIGN AND CONSTRUCTION OF THE PROJECT. THE USER OF THESE DRAWINGS, PERMITTER AND ASSUREE, SHALL BE RESPONSIBLE FOR THE DESIGN AND CONSTRUCTION OF THE PROJECT. THE USER OF THESE DRAWINGS, PERMITTER AND ASSUREE, SHALL BE RESPONSIBLE FOR THE DESIGN AND CONSTRUCTION OF THE PROJECT.

PROJECT: 450 DT NFRC 100/200/500

TESTING AGENCY: INTERTEK - ST. PAUL, MINNESOTA

REVISIONS

REV	INT'L	DATE
▲		
▲		
▲		
▲		
▲		
▲		
▲		

DATE DRAWN: 3-13-2017

DRAWN BY: GLH


SCALE: AS NOTED

SHEET: 1 OF 1

Standard Aluminum Association tolerances apply unless otherwise noted.				DIE NUMBER	REV
CUST PART #: 46010-00		TITLE BLOCK: REV A	EUC	CRO-115	
CUST PART NAME: GLAZING STOP		DIM AND TOL BLOCK REMOVED	103		
PROPOSAL:	REL. DATE 10/13/04 MRW	ALLOY 6063-T6		FINISH AE, PAINT, ANOD	





Report #: G9649
Date: 08/07/17
Verified by: 

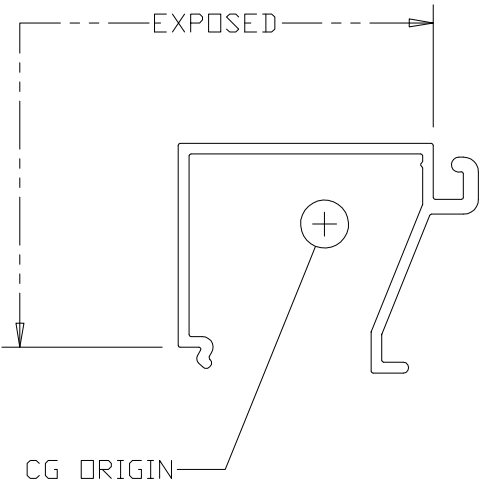

ACTUAL SIZE

DETAIL, "A"
SCALE, 4:1

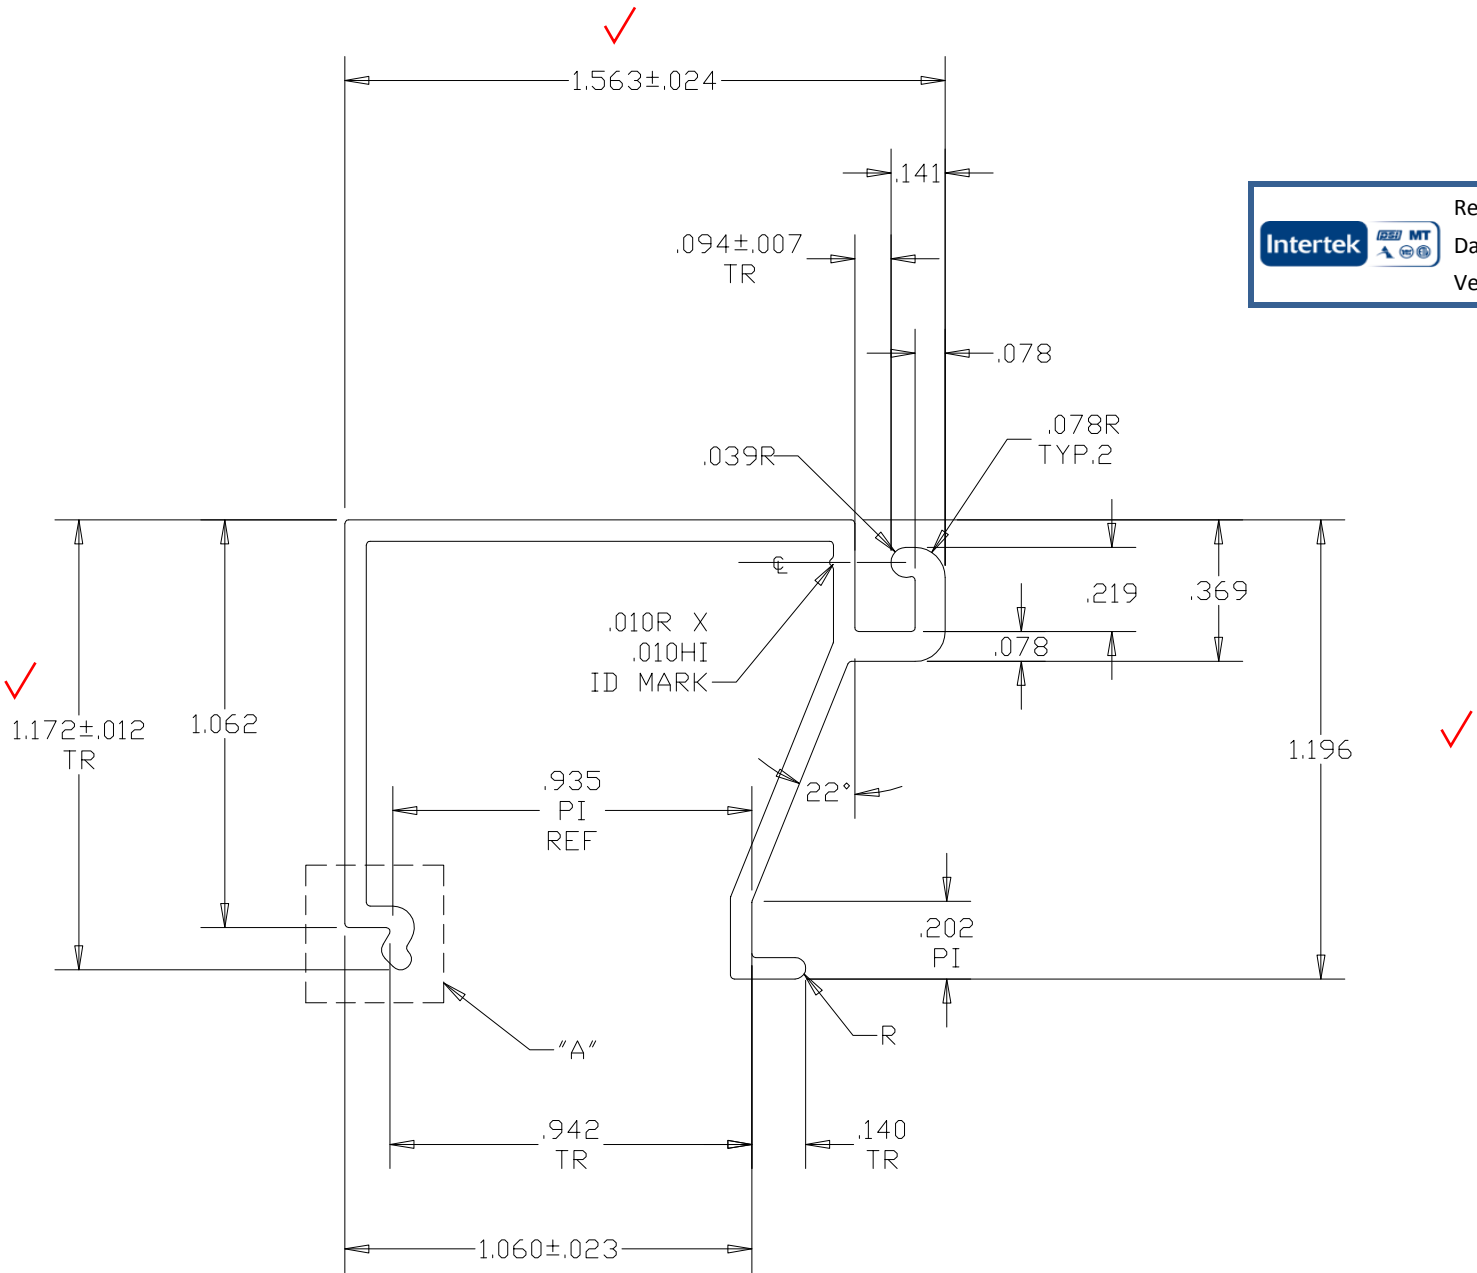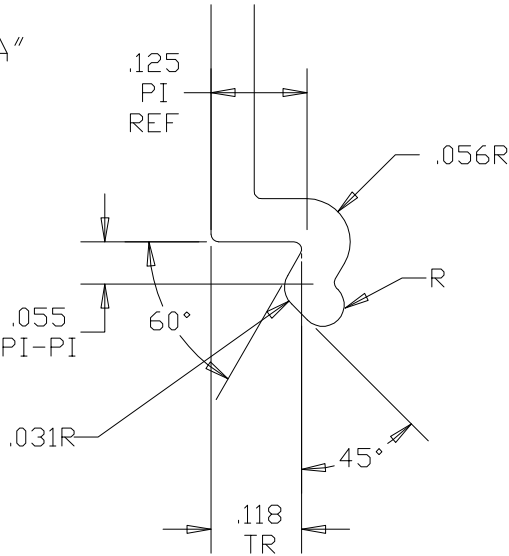

Aluminum Alloy - Anodized

Structural values estimated for reference only.					
Ix:	.0162 x 10 ⁶ mm ⁴	.039 in ⁴	Iy:	.0333 x 10 ⁶ mm ⁴	.080 in ⁴
Sx:	.825 x 10 ³ mm ³	.050 in ³	Sy:	1.637 x 10 ³ mm ³	.100 in ³
CGx:	19.69 mm	.775 in	CGy:	20.35 mm	.801 in



CRO-115

12343	CMI ARCHITECTURAL PRODS, INC. 608 4th STREET S.E. P.O. BOX T	UNSPECIFIED WALLS:	1.42 mm	MASS:	.457 kg/m	.307 lb/ft		
			.056 in	EST PER:	222.50 mm	8.760 in		
		UNSPECIFIED RADII:	.25R mm	OUT PER:	mm	in		
			.010R in	EXP PER:	mm	in		
DE SMET		SD	57231	DATE:	10/7/4	BUFF PER:	mm	in
THE WILLIAM L BONNELL CO CAPITOL PRODUCTS CORPORATION BON•L•CAMPO, LP BON•L•CANADA, INC SUBSIDIARIES OF TREDEGAR INDUSTRIES, INC				DRAWN:	MRW	BUFF TURNS:	CLASS:	Solid
				SCALE:	2:1	FACTOR:	487 metric	29 imperial
				THM BAR:	NO	C.C.D.:	49.99 mm	1.968 in
				P&D CODE:	NO	P&D AREA:	mm ²	in ²



 Report #: G9649
 Date: 08/07/17
 Verified by: *[Signature]*

Customer Number

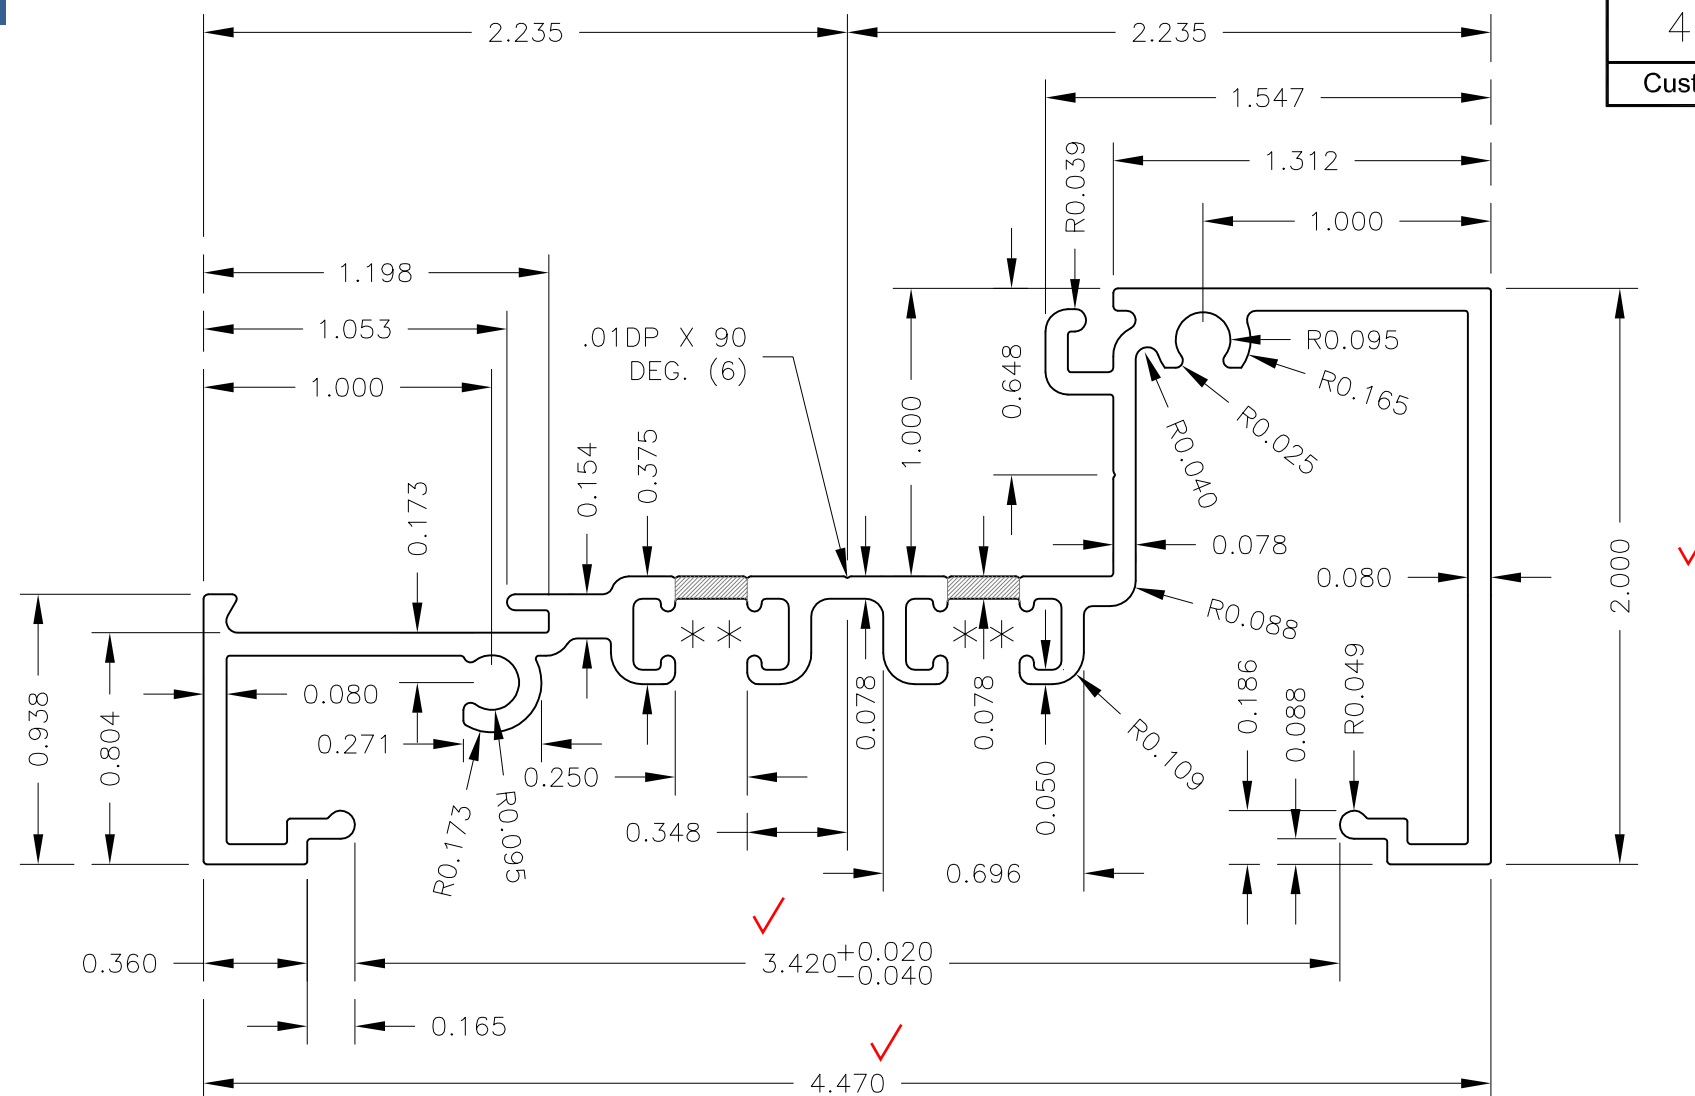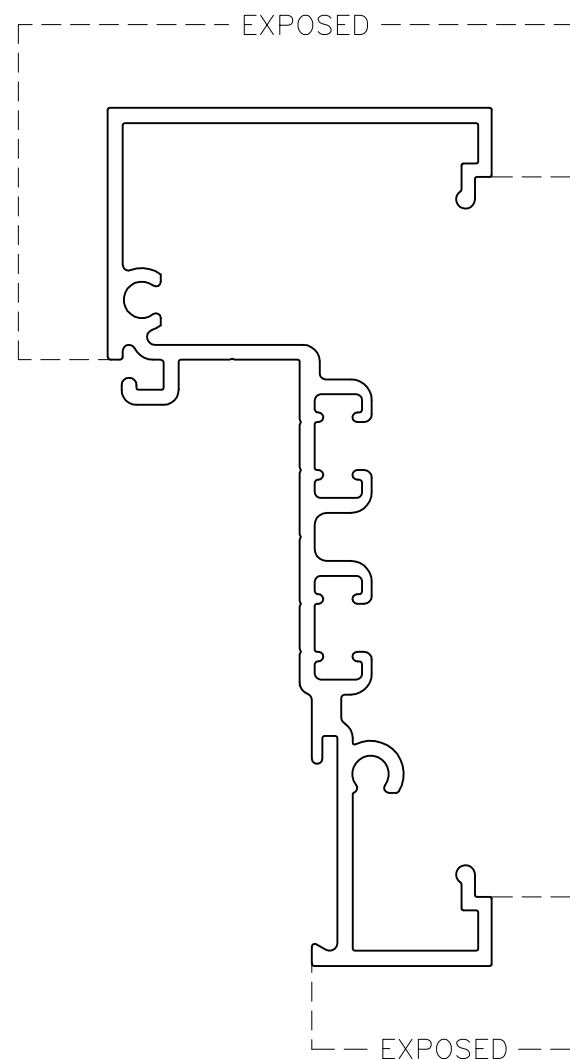

SCALE 1.5:1



= DE-BRIDGE FOR THERMAL BARRIER

ACTUAL SIZE

** POCKETS TO BE AZO-BRADED PRIOR TO FILLING WITH POLYURETHANE POLYMER THERMAL BARRIER.

STANDARD TOLERANCES APPLY UNLESS OTHERWISE NOTED

BREAK UNSPECIFIED CORNER: .010 R.

TYPICAL WALL UNLESS OTHERWISE NOTED: _____

ESTIMATED DIE DATA			
ALLOY/TEMPER:		6063-T6	
AREA	1.179	WT/FT	1.386
PERIMETER	24.818	CIRCLE SIZE	5-6
OUTSIDE PERIMETER	24.818	FACTOR	
EXPOSED PERIMETER	4.970	SOLID	



Crown Extrusions, Inc.
122 Columbia Court N.
Chaska, MN 55318
 952-448-3533 Fax: 952-448-5328

CUSTOMER

CMI Architectural
CMI Architectural Products, Inc.
20621 SD Highway 25
DeSmet, SD 57231-5827
605-854-3326 Fax: 605-854-3620

PART NAME:

450 DT SILL

DIE #	7835
SCALE	ACTUAL & NOTED
DATE	1-16-17
LAST REVISION	
DRAWN	GLH
CUSTOMER NUMBER	47-501

PRESS SIZE	EXPOSED PERIMETER	4.970	SOLID
LEGEND	DIE REVISIONS		DATE
• = .031 R.			
◦ = .062 R.			
× = .125 R.			
⊗ = .250 R.			
* =			




 Report #: G9649
 Date: 08/07/17
 Verified by: *[Signature]*

Customer Number

ACTUAL SIZE

** POCKETS TO BE AZO-BRADED PRIOR TO FILLING WITH POLYURETHANE POLYMER THERMAL BARRIER.

STANDARD TOLERANCES APPLY UNLESS OTHERWISE NOTED

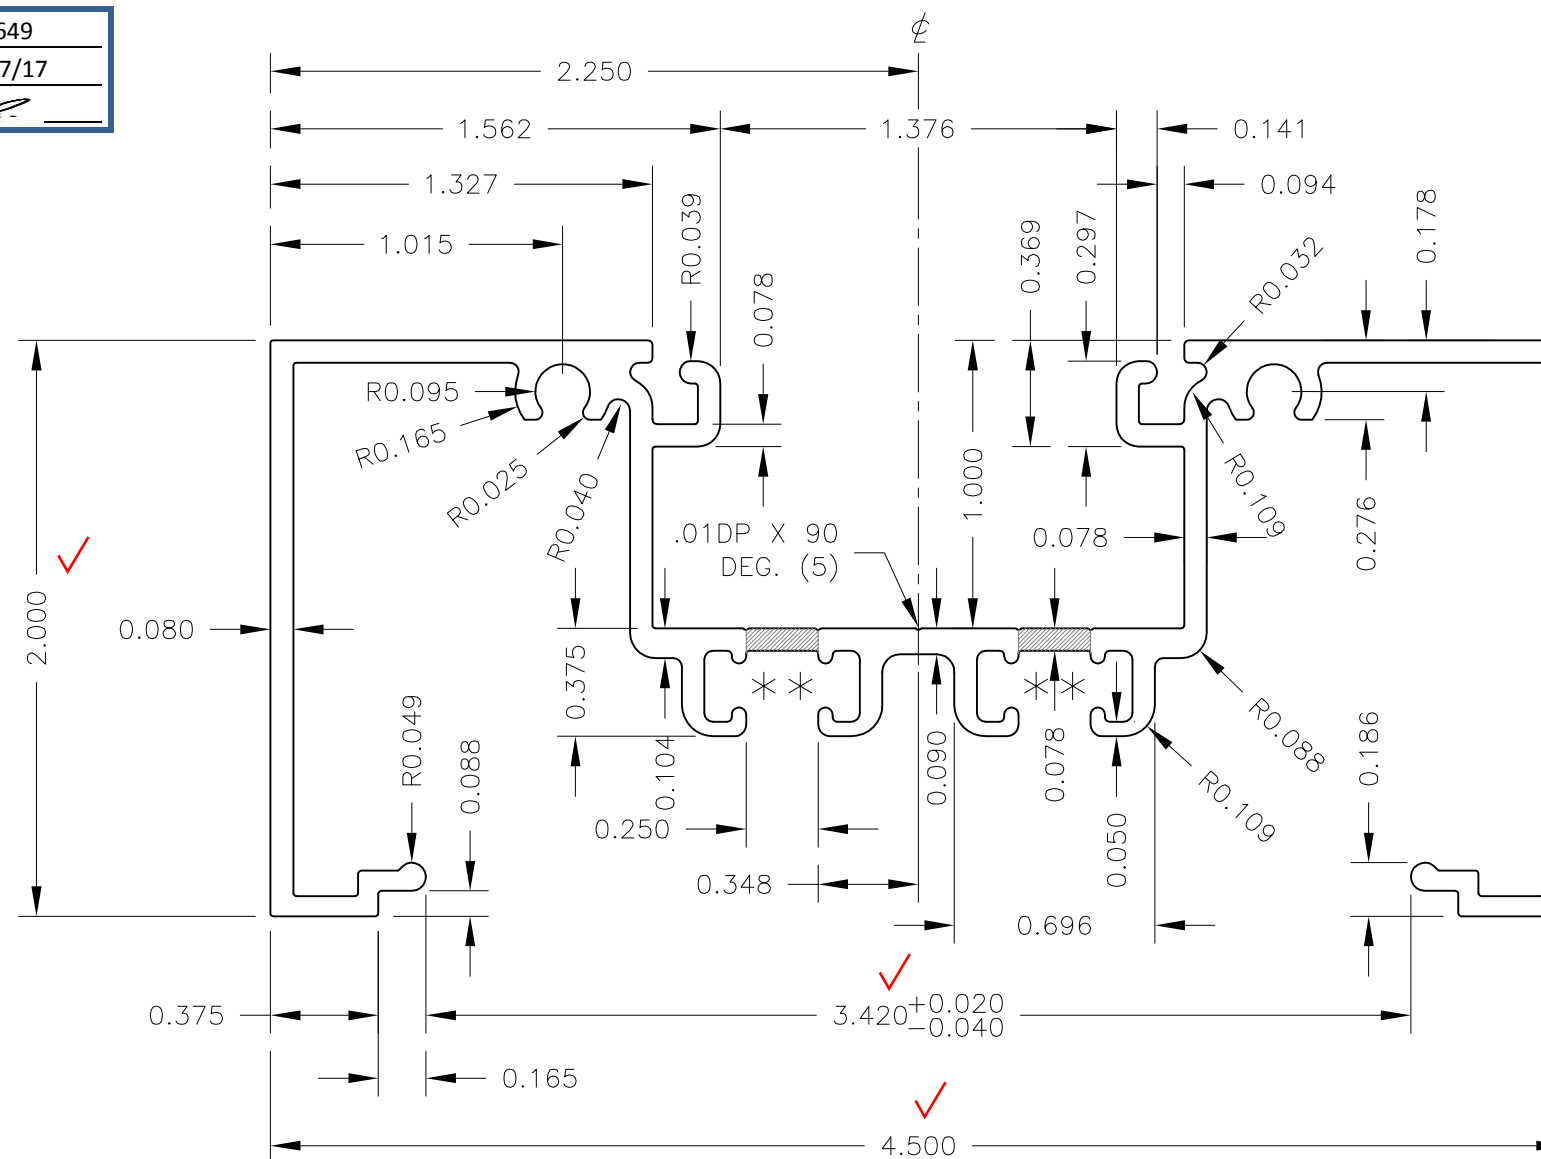

Aluminum Alloy - Anodized

SCALE 1.5:1



= DE-BRIDGE FOR THERMAL BARRIER

BREAK UNSPECIFIED CORNER: .010 R. TYPICAL WALL UNLESS OTHERWISE NOTED: _____

ESTIMATED DIE DATA			
ALLOY/TEMPER: 6063-T6			
AREA	0.997	WT/FT	1.172
PERIMETER	29.285	CIRCLE SIZE	5-6
OUTSIDE PERIMETER	29.285	FACTOR	
EXPOSED PERIMETER	7.404	SOLID	

PRESS SIZE	EXPOSED PERIMETER	7.404	SOLID
LEGEND	DIE REVISIONS		DATE
• = .031 R.			
◦ = .062 R.			
× = .125 R.			
⊗ = .250 R.			
* =			



Crown Extrusions, Inc.
122 Columbia Court N.
Chaska, MN 55318
 952-448-3533 Fax: 952-448-5328

CUSTOMER

CMI Architectural
CMI Architectural Products, Inc.
20621 SD Highway 25
DeSmet, SD 57231-5827
605-854-3326 Fax: 605-854-3620

PART NAME:	
------------	--

450 DT HEAD / JAMB

DIE #	7836
SCALE	ACTUAL & NOTED
DATE	1-16-17
LAST REVISION	
DRAWN	GLH
CUSTOMER NUMBER	47-502

PRINT REVISIONS		DATE



Report #:

G9649



Date:

08/07/17

Verified by:



7838
Die Number
47-535
Customer Number

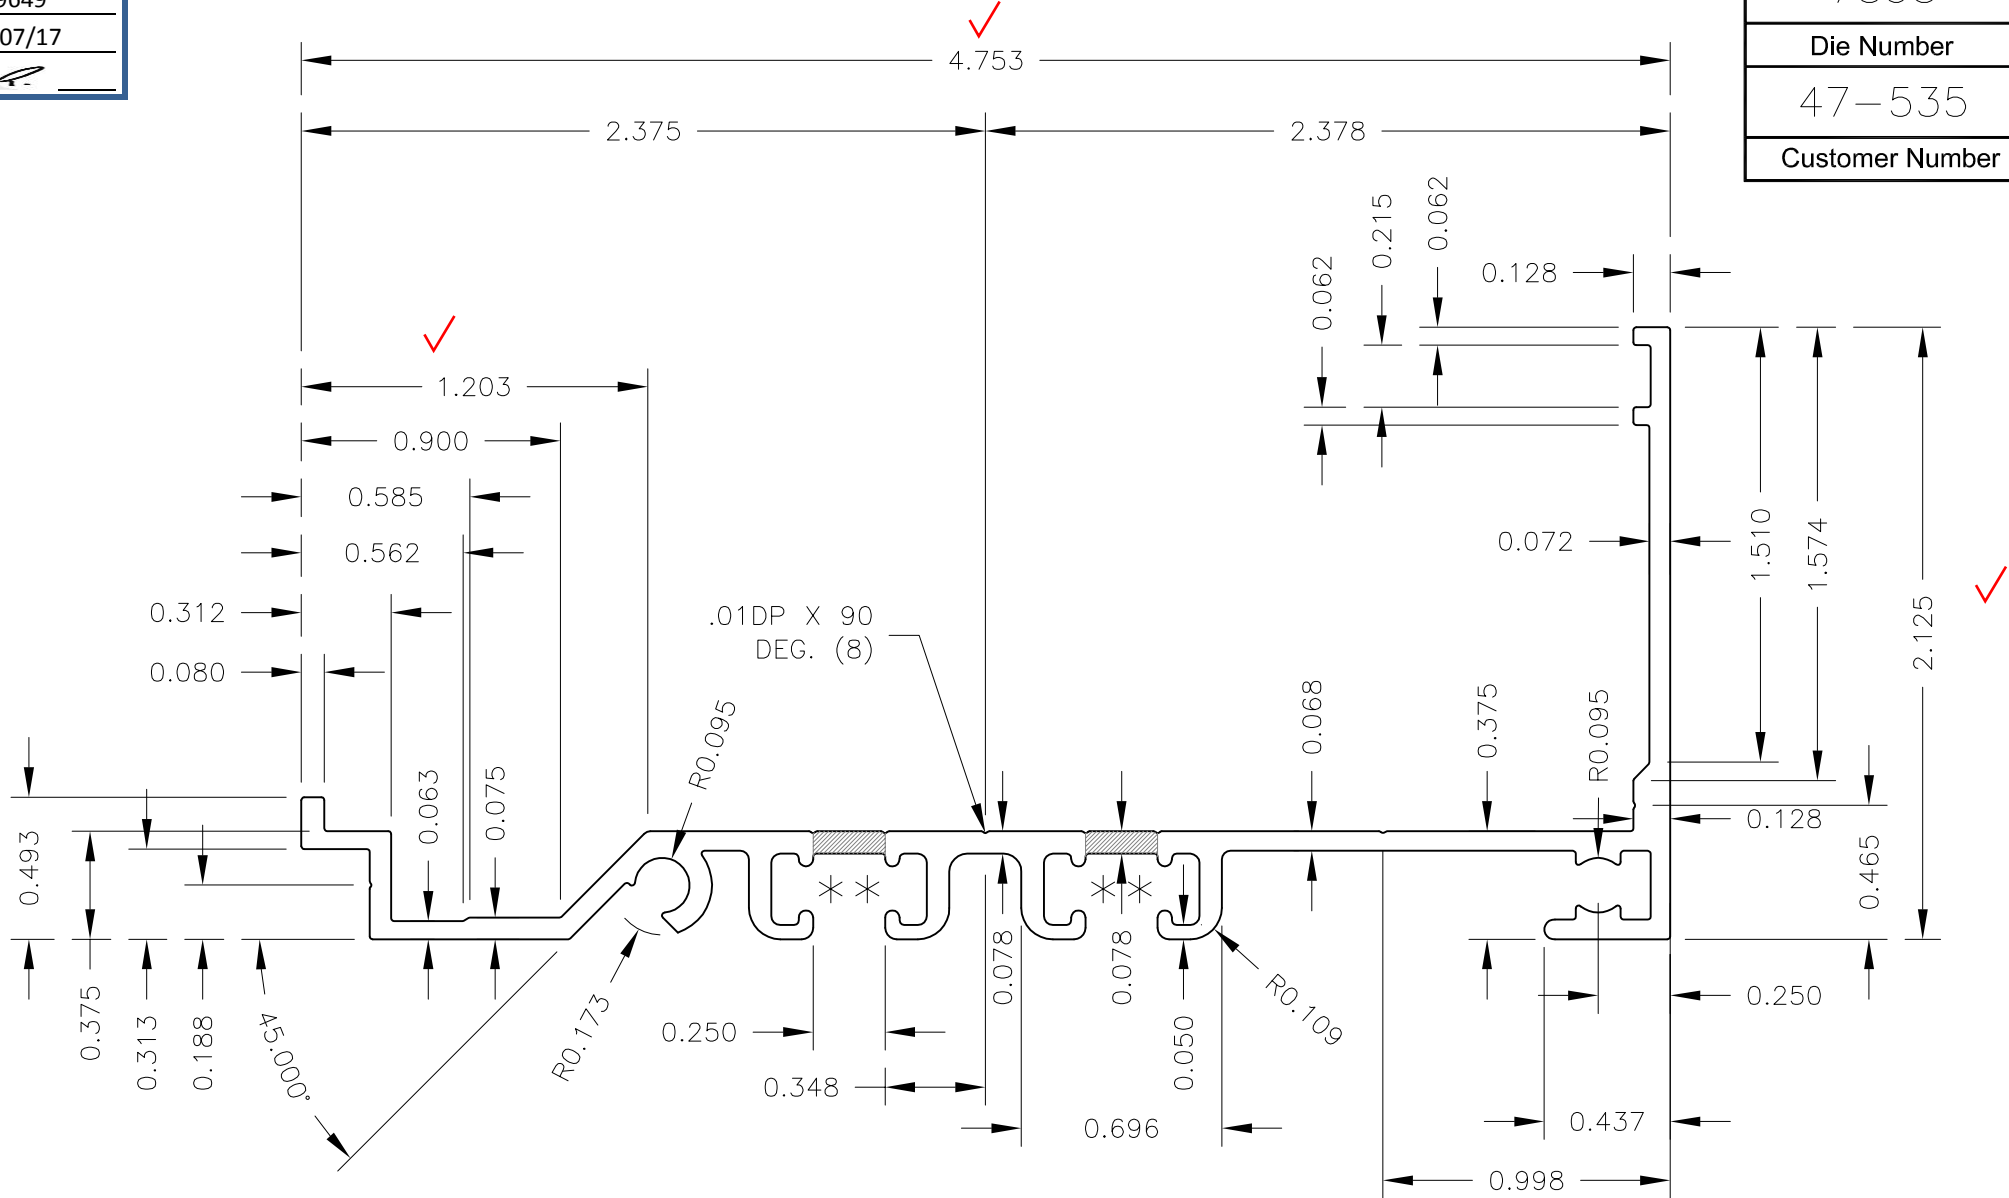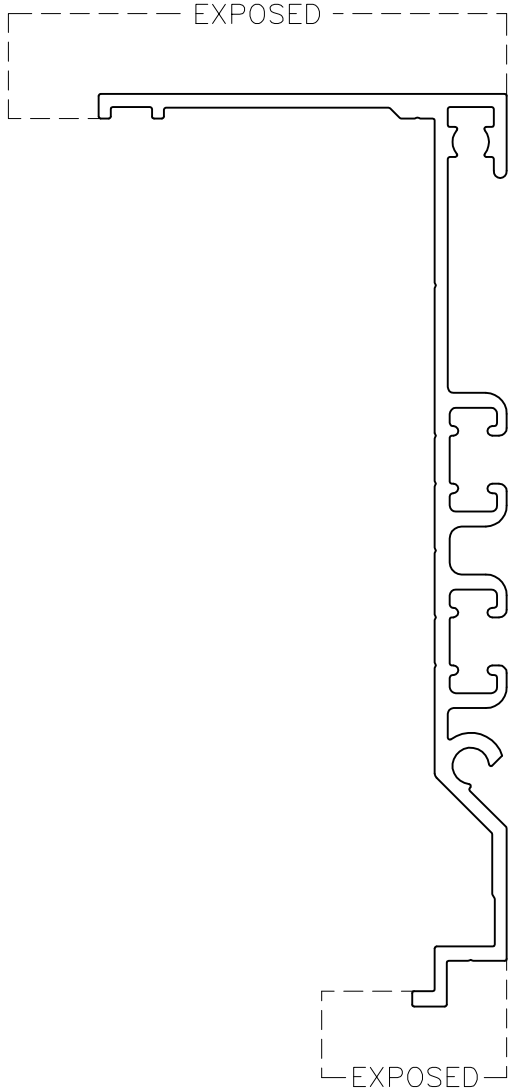

Aluminum Alloy - Anodized

SCALE 1.5:1

 = DE-BRIDGE FOR THERMAL BARRIER

ACTUAL SIZE

** POCKETS TO BE AZO-BRADED PRIOR TO FILLING WITH POLYURETHANE POLYMER THERMAL BARRIER.

STANDARD TOLERANCES APPLY UNLESS OTHERWISE NOTED

BREAK UNSPECIFIED CORNER: .010 R. TYPICAL WALL UNLESS OTHERWISE NOTED: _____

ESTIMATED DIE DATA			
ALLOY/TEMPER:		6063-T6	
AREA	0.742	WT/FT	0.873
PERIMETER	20.116	CIRCLE SIZE	5-6
OUTSIDE PERIMETER	20.116	FACTOR	
EXPOSED PERIMETER	3.063	SOLID	

PRESS SIZE	DIE REVISIONS		DATE
LEGEND			
• = .031 R.			
o = .062 R.			
x = .125 R.			
⊗ = .250 R.			
* =			



Crown Extrusions, Inc.
122 Columbia Court N.
Chaska, MN 55318
952-448-3533 Fax: 952-448-5328

CUSTOMER **CMI Architectural**
CMI Architectural Products, Inc.
20621 SD Highway 25
DeSmet, SD 57231-5827
605-854-3326 Fax: 605-854-3620

PART NAME: 450 DT SUB-SILL




DIE #	7838
SCALE	ACTUAL & NOTED
DATE	1-16-17
LAST REVISION	
DRAWN	GLH
CUSTOMER NUMBER	47-535

PRINT REVISIONS		DATE




Report #: G9649
Date: 08/07/17
Verified by: 

7839
Die Number
32-101
Customer Number

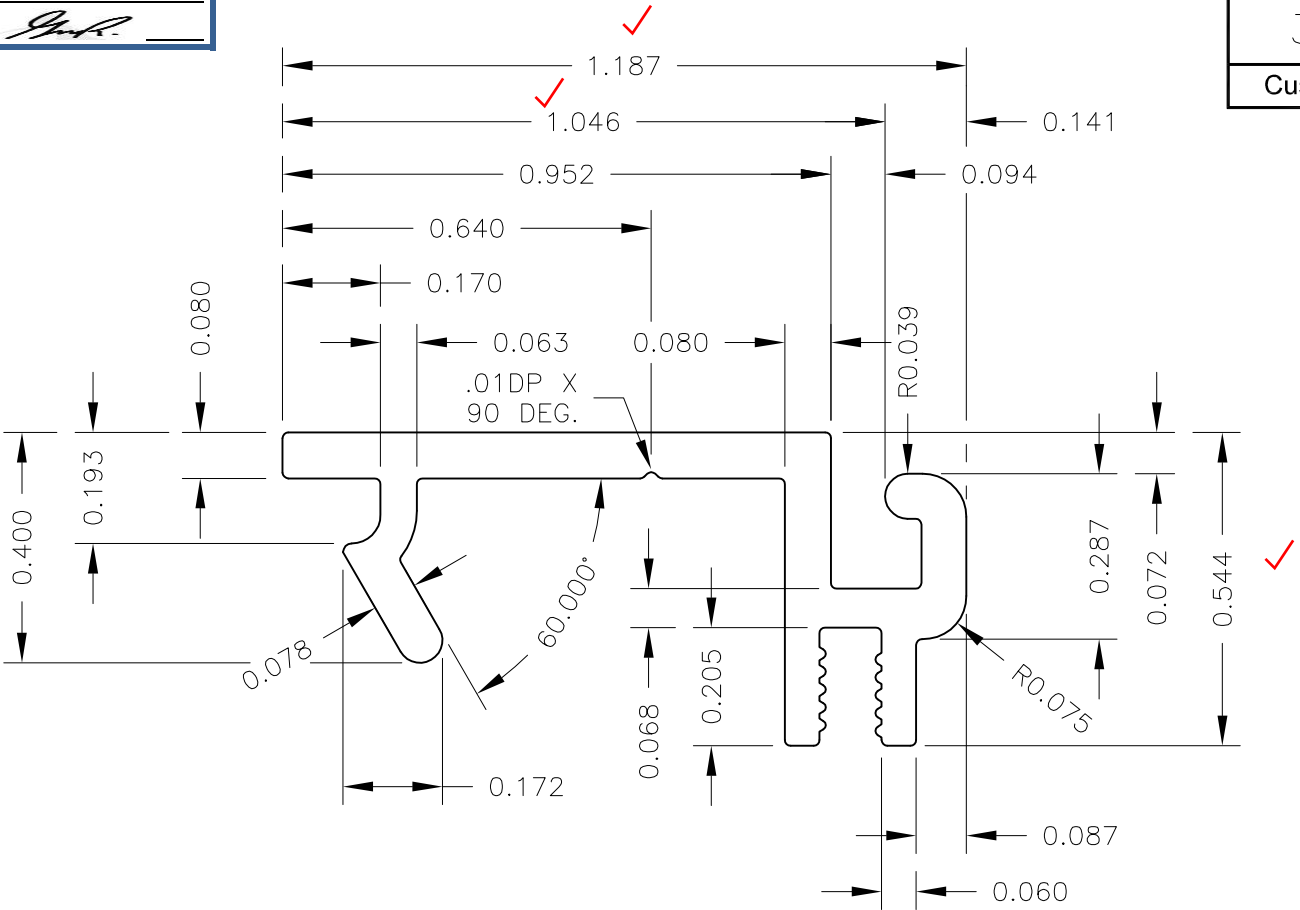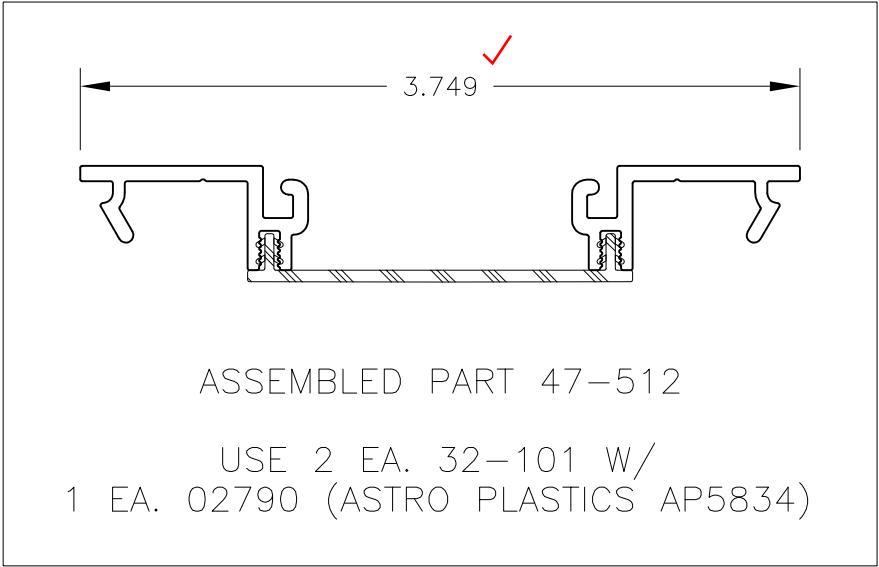

ACTUAL SIZE

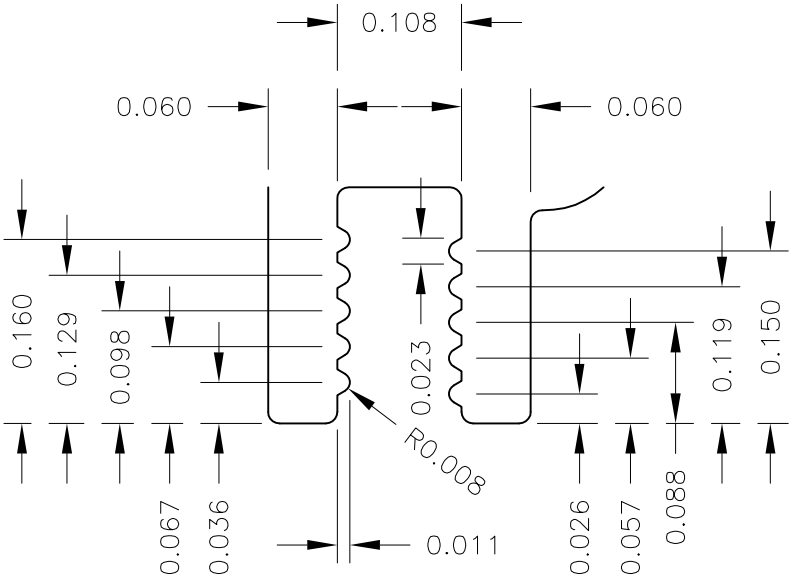


SCALE 6:1

Aluminum Alloy - Anodized

SCALE 3:1

BREAK UNSPECIFIED CORNER: .010 R. TYPICAL WALL UNLESS OTHERWISE NOTED: _____

		ESTIMATED DIE DATA		 Crown Extrusions, Inc. 122 Columbia Court N. Chaska, MN 55318 952-448-3533 Fax: 952-448-5328		DIE #	7839
		ALLOY/TEMPER: 6063-T6				SCALE	ACTUAL & NOTED
		AREA 0.185	WT/FT 0.218			DATE	1-16-17
		PERIMETER 5.206	CIRCLE SIZE 5-6			LAST REVISION	
		OUTSIDE PERIMETER 5.206	FACTOR			DRAWN	GLH
PRESS SIZE	EXPOSED PERIMETER 0.952	SOLID		CMI Architectural CMI Architectural Products, Inc. 20621 SD Highway 25 DeSmet, SD 57231-5827 605-854-3326 Fax: 605-854-3620		CUSTOMER NUMBER	32-101
LEGEND		DIE REVISIONS				PART NAME: 450 DT VERTICAL FILLER	
• = .031 R.		NEW DIE	3/13/17				
o = .062 R.							
x = .125 R.							
⊗ = .250 R.							
* =							

STANDARD TOLERANCES APPLY UNLESS OTHERWISE NOTED

Intertek



Report #: G9649

Date: 08/07/17

Verified by: *[Signature]*


REGRIND DIE

Your signature on this print indicates your approval of design and dimensions as shown. Please sign and return as soon as possible. Die construction cannot proceed until approval is received.

Approved: DECEMBER 20 09

Customer: CMI

Per:

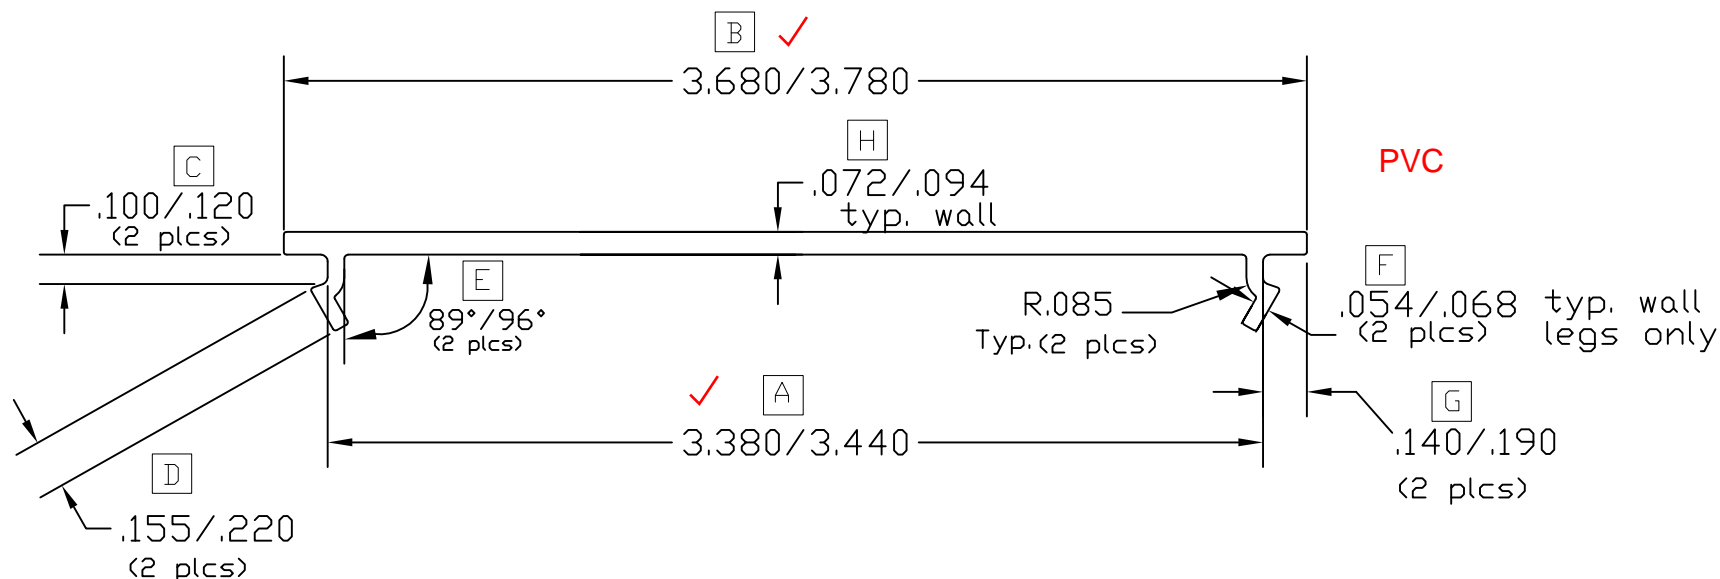

REVISIONS

NO.	DESCRIPTION	DATE	BY
1	C WAS .100/.117	4/18/02	JB
1	E WAS 88°/92°	4/18/02	JB
1	G WAS .150/.170	4/18/02	JB
1	H WAS .075/.088	4/18/02	JB
2	C WAS .100/.120	12/15/09	JB
2	D WAS .160/.190	12/15/09	JB
2	F WAS .055/.065	12/15/09	JB
2	G WAS .150/.180	12/15/09	JB
2	H WAS .075/.092	12/15/09	JB

ASTRO PLASTICS

COVINGTON, GA ROSEMOUNT, MN

CMI

Open Back Filler

DATE 3/21/02

SCALE nts

DRAWN BY JB

DRAWING NO.

MATERIAL PVC Color: Black

APPRD. BY JB

AP 4588

CONFIDENTIAL THE DESIGN OF THE PARTS REPRESENTED BY THESE DRAWINGS IS PROPRIETARY TO ASTRO PLASTICS AND CANNOT BE REPRODUCED, COPIED, OR DISCLOSED WITHOUT THE EXPRESS WRITTEN CONSENT OF ASTRO PLASTICS. ASTRO PLASTICS WARRANTS THAT THE PARTS REPRESENTED HEREON WILL CONFORM TO THE SPECIFICATIONS INDICATED ON THESE DRAWINGS, BUT ASTRO PLASTICS MAKES NO WARRANTY, EXPRESSED OR IMPLIED, AND SPECIFICALLY DISCLAIMS INTENDED USE. COPYRIGHT © 2002 ASTRO PLASTICS

Your signature on this print indicates your approval of design and dimensions as shown. Please sign and return as soon as possible. Die construction cannot proceed until approval is received.


Approved _____ 20 ____

Customer _____

Per _____

NOTE: TRY TO HOLD DIMENSION F AT .125.

Intertek A MT	Report #:	G9649
	Date:	08/07/17
	Verified by:	<i>[Signature]</i>

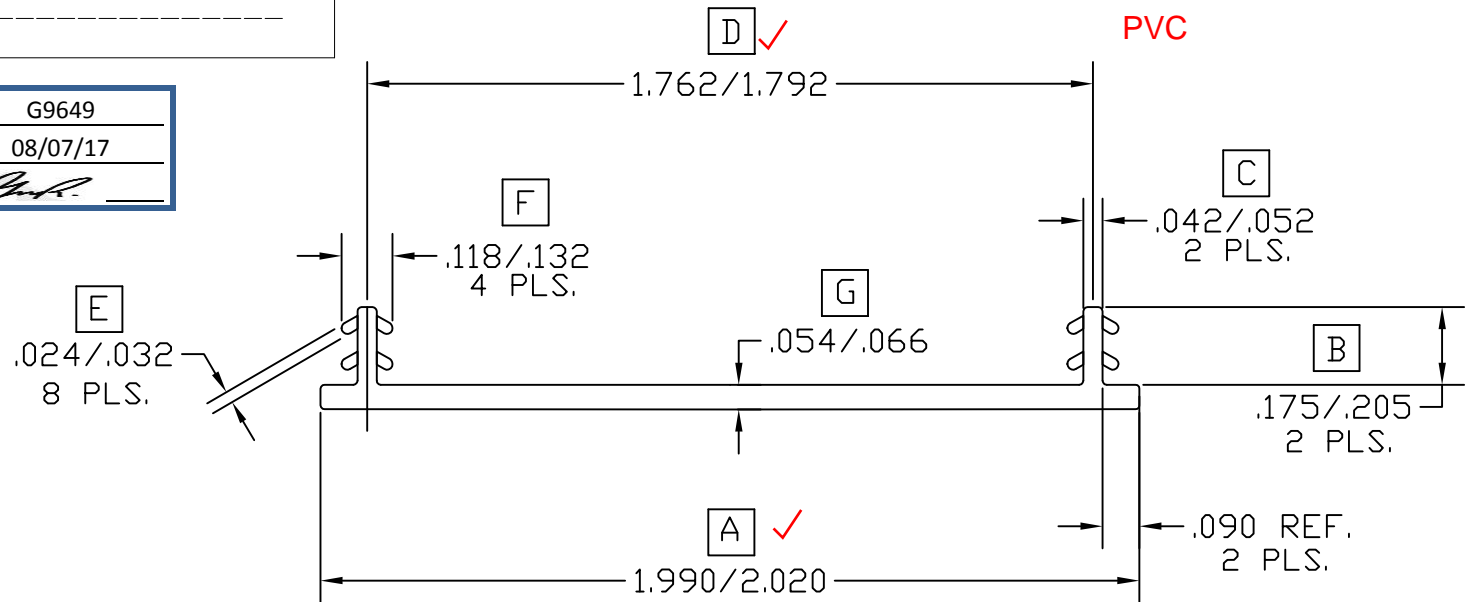

REVISIONS


NO.	DESCRIPTION	DATE	BY
F	WAS .135/.149	3/13/17	ML

1. BOND IS CRITICAL
2. FIT GAUGE IS CRITICAL.

S

QUOTE # R-16610		CUSTOMER PART # 02790		TRACKING / X #	
ASTRO PLASTICS COVINGTON, GA ROSEMOUNT, MN		CMI ARCHITECTURAL 450 DT VERTICAL FILLER		DATE 1/25/17	SCALE NONE
				MATERIAL DUAL PVC	DRAWN BY ML
				APPRD. BY JN	DRAWING NO. AP5834

CONFIDENTIAL THE DESIGN OF THE PARTS REPRESENTED BY THESE DRAWINGS IS PROPRIETARY TO ASTRO PLASTICS AND CANNOT BE REPRODUCED, COPIED, OR DISCLOSED WITHOUT THE EXPRESS WRITTEN CONSENT OF ASTRO PLASTICS. ASTRO PLASTICS WARRANTS THAT THE PARTS REPRESENTED HEREON WILL CONFORM TO THE SPECIFICATIONS INDICATED ON THESE DRAWINGS, BUT ASTRO PLASTICS MAKES NO WARRANTY, EXPRESSED OR IMPLIED, AND SPECIFICALLY DISCLAIMS INTENDED USE. COPYRIGHT © 2011 ASTRO PLASTICS

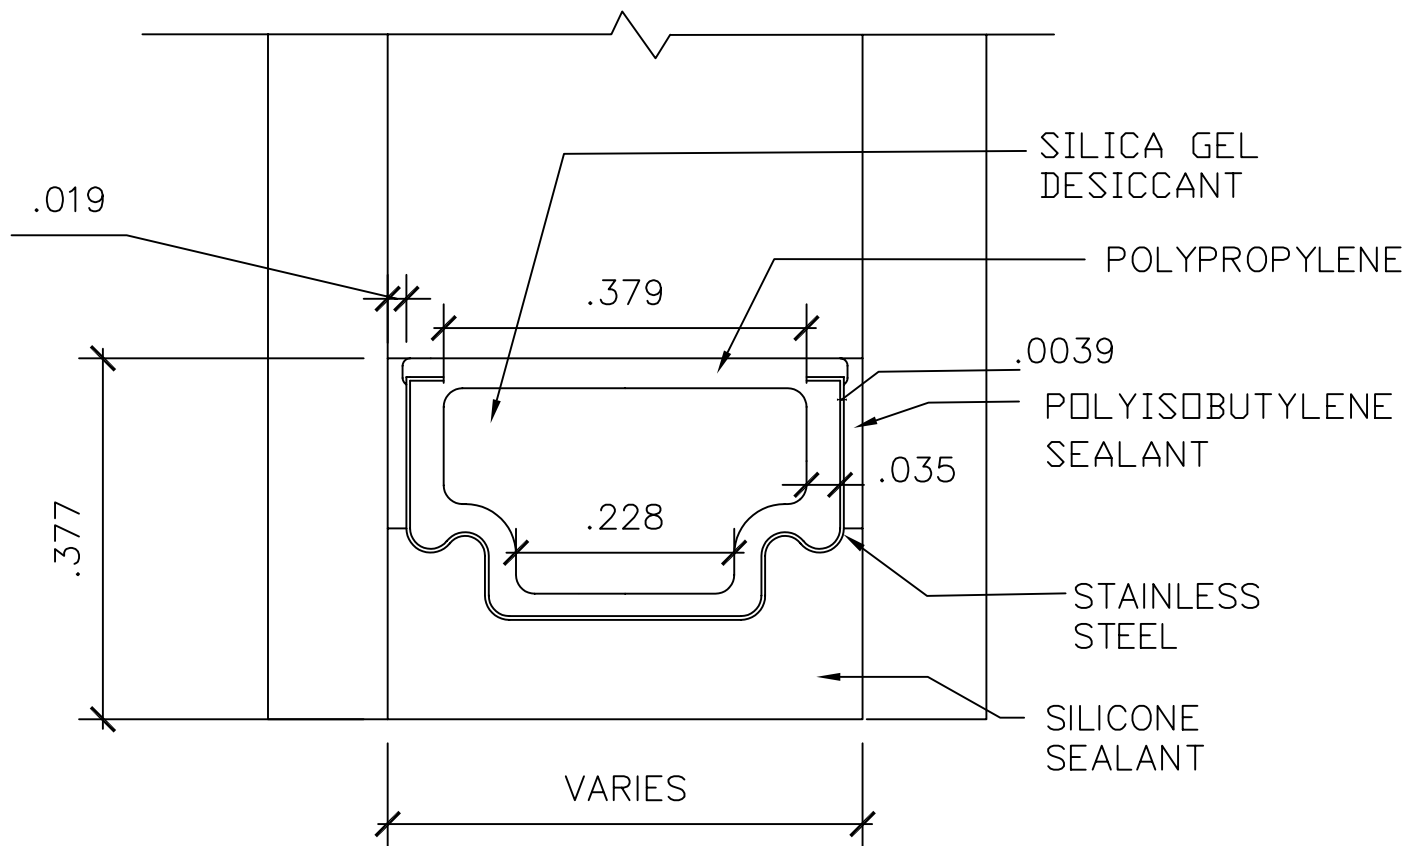

DETAIL FOR THERMAL MODELING OF
TGI WAVE SPACER (TS-D)